



Approval body for construction products and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and Laender Governments



European Technical Assessment

ETA-17/0785 of 13 December 2017

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the European Technical Assessment:

Trade name of the construction product

Product family to which the construction product belongs

Manufacturer

Manufacturing plant

This European Technical Assessment contains

This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of

Deutsches Institut für Bautechnik

fischer injection system FORZA PRO for use in masonry

Injection system for use in masonry

fischerwerke GmbH & Co. KG Klaus-Fischer-Straße 1 72178 Waldachtal DEUTSCHLAND

fischerwerke

26 pages including 3 annexes which form an integral part of this assessment

ETAG 029, April 2013, used as EAD according to Article 66 Paragraph 3 of Regulation (EU) No 305/2011.



European Technical Assessment ETA-17/0785

Page 2 of 26 | 13 December 2017

English translation prepared by DIBt

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.



European Technical Assessment ETA-17/0785 English translation prepared by DIBt

Page 3 of 26 | 13 December 2017

Specific Part

1 Technical description of the product

The fischer injectionsystem FORZA PRO for masonry is a bonded anchor (injection type) consisting of a mortar cartridge with fischer injection mortar FORZA PRO, FORZA PRO Low Speed and FORZA PRO High Speed, a perforated sieve sleeve and an anchor rod with hexagon nut and washer or an internal threaded rod. The steel elements are made of zinc coated steel, stainless steel or high corrosion resistant steel.

The anchor rod is placed into a drilled hole filled with injection mortar and is anchored via the bond between steel element, injection mortar and masonry and mechanical interlock.

The product description is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Mechanical resistance and stability (BWR 1)

| Essential characteristic | Performance |
|---|---------------------|
| Characteristic resistance for tension and shear loads | See Annex C 1 – C 4 |
| Characteristic resistance for bending moments | See Annex C 5 |
| Displacements under shear and tension loads | See Annex C 5 |
| Reduction Factor for job site tests (β-Factor) | See Annex C 6 |
| Edge distances and spacing | See Annex C 7 – C8 |

3.2 Safety in case of fire (BWR 2)

| Essential cha | racteristic | Performance |
|------------------|-------------|--|
| Reaction to fire | е | Anchorages satisfy requirements for Class A1 |
| Resistance to | fire | No performance assessed |

3.3 Hygiene, health and the environment (BWR 3)

Regarding dangerous substances there may be requirements (e.g. transposed European legislation and national laws, regulations and administrative provisions) applicable to the products falling within the scope of this European Technical Assessment. In order to meet the provisions of Regulation (EU) No 305/2011, these requirements need also to be complied with, when and where they apply.





European Technical Assessment ETA-17/0785

Page 4 of 26 | 13 December 2017

English translation prepared by DIBt

3.4 Safety in use (BWR 4)

The essential characteristics regarding Safety in use are included under the Basic Works Requirement Mechanical resistance and stability.

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with guideline for European technical approval ETAG 029, April 2013 used as European Assessment Document (EAD) according to Article 66 Paragraph 3 of Regulation (EU) No 305/2011 the applicable European legal act is: [97/177/EC].

The system to be applied is: 1

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.

Issued in Berlin on 13 December 2017 by Deutsches Institut für Bautechnik


BD Dipl.-Ing. Andreas Kummerow Head of Department

beglaubigt: Baderschneider



Installation conditions part 1;


Threaded rods with perforated sleeve FIS H K; Installation in perforated and solid brick masonry

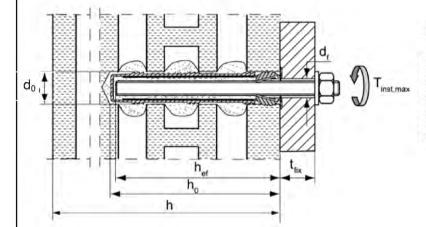

Pre-positioned installation

FIS H 12x85 K FIS H 16x85 K FIS H 16x130 K FIS H 20x85 K FIS H 20x130 K FIS H 20x200 K

Internal threaded anchors FIS E with perforated sleeve FIS H K; Installation in perforated and solid brick masonry

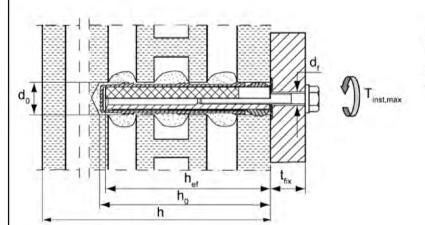

Pre-positioned installation

FIS H 16x85 K - FIS E 11x85 M6 and M8 FIS H 20x85 K- FIS E 15x85 M10 and M12

effective anchorage depth

 $h_0 = depth of drill hole$ t_{fix} = thickness of fixture

thickness of masonry

d₀= nominal drill bit diameter

d_f= diameter of clearance hole in the fixture

T_{inst,max} = maximum torque moment

fischer Injectionsystem FORZA PRO for masonry

Product description

Installation condition, part 1: in perforated and solid brick masonry

Annex A 1


Z2933.18




Installation conditions part 2;

Threaded rods without perforated sleeve FIS H K; Installation in solid brick masonry and autoclaved aerated concrete


Pre-positioned installation

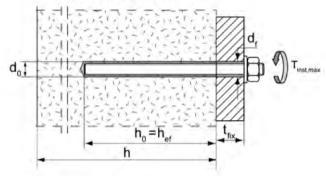





Internal threaded anchors FIS E without perforated sleeve FIS H K; Installation in solid brick masonry and autoclaved aerated concrete

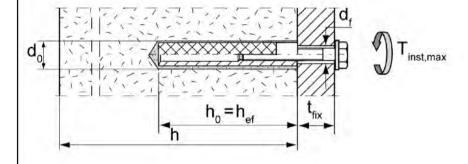

Pre-positioned installation

FIS E 11x85 M6 FIS E 11x85 M8 FIS E 15x85 M10 FIS E 15x85 M12

h_{ef} = effective anchorage depth

 $h_0 =$ depth of drill hole

t_{fix} = thickness of fixtureh = thickness of masonry

d₀= nominal drill bit diameter

d_f= diameter of clearance hole in the fixture

T_{inst,max} = maximum torque moment

fischer Injectionsystem FORZA PRO for masonry

Product description

Installation condition, part 2: in solid brick masonry and aerated concrete

Annex A 2



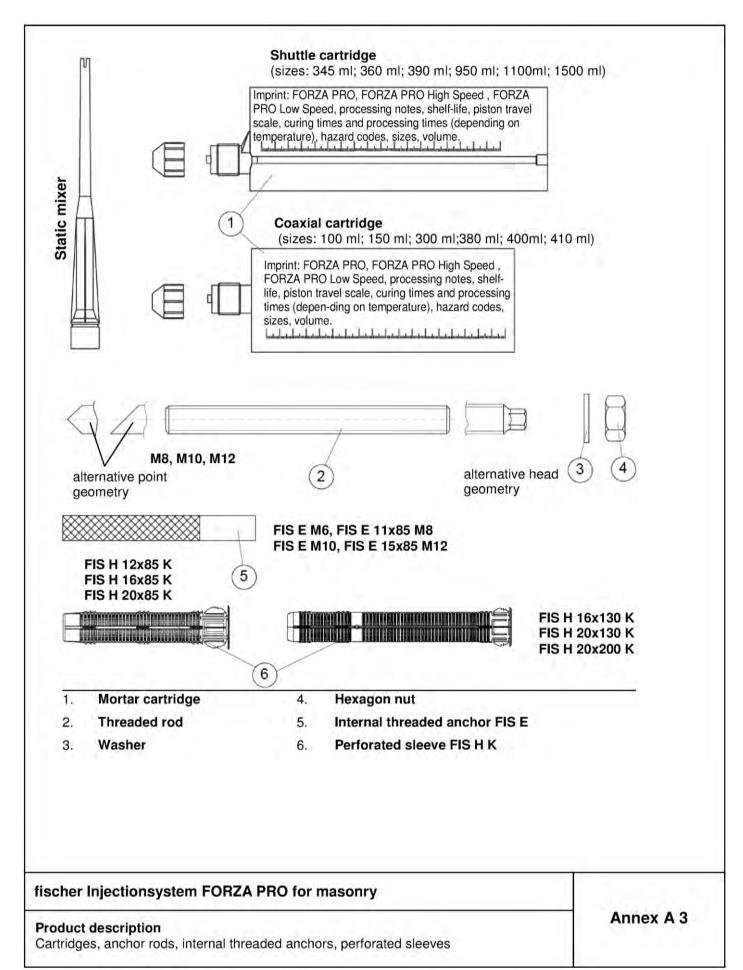




Table A1: Materials

| Part | Designation | Material | | | | | | | |
|------|--|---|---|--|--|--|--|--|--|
| 1 | Mortar cartridge | ı | mortar, hardener; filler | | | | | | |
| | | Steel, zinc plated | Stainless steel A4 | High corrosion- resistant steel C | | | | | |
| 2 | | Property class 5.8 or 8.8; EN ISO 898-1:2013 zinc plated $\geq 5 \mu m$, EN ISO 4042:1999 A2K or hot-dip galvanized $\geq 40 \mu m$ EN ISO 10684:2004 $f_{uk} \leq 1000 \text{ N/mm}^2$ $A_5 > 8 \%$ fracture elongation | Property class 50, 70 or 80 EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; 1.4062, 1.4462 EN 10088-1:2014 $f_{uk} \le 1000 \text{ N/mm}^2$ $A_5 > 8 \%$ fracture elongation | Property class 50 or 80 EN ISO 3506-1:2009 or property class 70 with f_{yk} = 560 N/mm ² 1.4565; 1.4529 EN 10088-1:2014 $f_{uk} \le 1000 \text{ N/mm}^2$ $A_5 > 8 \%$ fracture elongation | | | | | |
| 3 | Washer ISO 7089:2000 | zinc plated ≥ 5 μm, EN ISO 4042:1999 A2K or hot-dip galvanized ≥ 40 μm EN ISO 10684:2004 | 1.4401; 1.4404; 1.4578;1.4571; 1.4439; 1.4362 EN 10088-1:2014 | 1.4565;1.4529 EN 10088-1:2014 | | | | | |
| 4 | Hexagon nut | Property class 5 or 8; EN ISO 898-2:2012 zinc plated ≥ 5 μm, ISO 4042:1999 A2K or hot-dip galvanized ≥ 40 μm EN ISO 10684:2004 | Property class 50, 70 or 80 EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362 EN 10088-1:2014 | Property class 50, 70 or 80 EN ISO 3506-1:2009 1.4565; 1.4529 EN 10088-1:2014 | | | | | |
| 5 | Internal threaded anchor FIS E | Property class 5.8 EN 10277-1:2008-06 zinc plated ≥ 5 μm, ISO 4042:1999 A2K | Property class 70 EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362 EN 10088-1:2014 | Property class 70 EN ISO 3506-1:2009 1.4565; 1.4529 EN 10088-1:2014 | | | | | |
| | Screw or threaded rod for internal threaded anchor FIS E | Property class 5.8 or 8.8; EN ISO 898-1:2013 zinc plated ≥ 5 μm, ISO 4042:1999 A2K | Property class 70 EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362 EN 10088-1:2014 | Property class 70 EN ISO 3506-1:2009 1.4565; 1.4529 EN 10088-1:2014 | | | | | |
| 6 | Perforated sleeve FIS H K | | PP / PE | | | | | | |

| fischer Injectionsystem FORZA PRO for masonry | |
|---|-----------|
| Product description Materials | Annex A 4 |

English translation prepared by DIBt



Specifications of intended use part 1

Anchorages subject to:

Static and quasi-static loads

Base materials:

- Solid brick masonry (Use category b) and autoclaved aerated concrete (Use category d), acc. to Annex B8.
 Note: The characteristic resistance is also valid for larger brick sizes and higher compressive strength of the masonry unit.
- Hollow brick masonry (use category c), according to Annex B8
- Mortar strength class of the masonry M2,5 at minimum according to EN 998-2:2010
- For other bricks in solid masonry, hollow or perforated masonry and autoclaved aerated concrete, the characteristic resistance of the anchor may be determined by job site tests according to ETAG 029, Annex B under consideration of the β-factor according to Annex C6, Table C4

Temperature Range:

electronic copy of the eta by dibt: eta-17/0785

From - 40°C to +80°C (max. short term temperature +80°C and max. long term temperature +50°C)

Use conditions (Environmental conditions):

- Dry and wet structure (regarding injection mortar)
- Structures subject to dry internal conditions exist
 (zinc coated steel, stainless steel or high corrosion resistant steel)
- Structures subject to external atmospheric exposure including industrial and marine environment or exposure to permanently damp internal condition, if no particular aggressive conditions exist (stainless steel or high corrosion resistant steel)
- Structures subject to external atmospheric exposure and to permanently damp internal condition, if other particular aggressive conditions exist (high corrosion resistant steel)
 - Note: Particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used)

| fischer Injectionsystem FORZA PRO for masonry | |
|---|-----------|
| Intended Use Specifications part 1 | Annex B 1 |



Specifications of intended use part 2

Design:

- The anchorages have to be designed in accordance with the ETAG 029, Annex C, Design method A under the responsibility of an engineer experienced in anchorages and masonry work
 - Applies to all bricks, if no other values are specified:

$$N_{Rk} = N_{Rk,s} = N_{Rk,p} = N_{Rk,b} = N_{Rk,pb}$$

$$V_{Rk} = V_{Rk,s} = V_{Rk,b} = V_{Rk,c} = V_{Rk,pb}$$

Verifiable calculation notes and drawings have to be prepared taking account the relevant masonry in the
region of the anchorage, the loads to be transmitted and their transmission to the supports of the structure. The
position of the anchor is indicated on the design drawings

Installation:

- Category d/d: -Installation and use in dry structures
- · Category w/w: -Installation and use in dry and wet structures
- Hole drilling by hammer drill mode
- · In case of aborted hole: The hole shall be filled with mortar
- Bridging of unbearing layer (e.g. plaster) see Annex B 4 (Table B1.3)
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site
- Fastening screws or threaded rods (including nut and washer) must comply with the appropriate material and property class of the fischer internal threaded anchor FIS E
- minimum curing time see Annex B5. Table B3
- Commercial standard threaded rods, washers and hexagon nuts may also be used if the following requirements are fulfilled:


Material dimensions and mechanical properties of the metal parts according to the specifications are given in Annex A4, Table A1

Conformation of material and mechanical properties of the metal parts by inspection certificate 3.1 according to EN 10204:2004, the documents shall be stored

Marking of the threaded rod with the envisage embedment depth. This may be done by the manufacturer of the rod **or** by a person on job site

| fischer Injectionsystem FORZA PRO for masonry | |
|---|-----------|
| Intended Use Specifications part 2 | Annex B 2 |



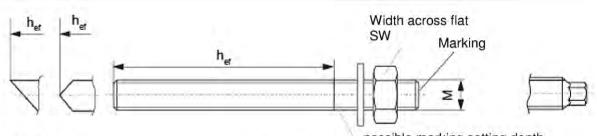

Marking:

possible marking setting depth

Property class (p.c.) 8.8, Stainless steel A4, p.c. 80 or high corrosion-resistant steel C, property class 80: • Stainless steel A4, property class 50 and high corrosion-resistant steel C, property class 50: ••

Table B1.1: Installation parameters for threaded rod without perforated sleeve

| Size | | | | M8 | M10 | M12 |
|--|------------------------|-----------------------|------|----------|-------|-----|
| Nominal drill hole diame | eter | $d_{nom}=d_0$ | [mm] | 10 | 12 | 14 |
| Width across flat | SW | [mm] | 13 | 17 | 19 | |
| Effective anchorage de | pth ¹⁾ | h _{ef,min} | [mm] | | 50 | |
| Depth of drill hole $h_0 = 1$ | h _{ef,max} | [mm] | h-30 | and ≤ 20 | 00 mm | |
| Effective anchorage do | h _{ef,min} | mm] | 100 | | | |
| Effective anchorage depth AAC | | h _{et,max} | [mm] | | 120 | |
| Maximum torque mome | ent | T _{inst,max} | [Nm] | 10 | | |
| Max. torque moment for autoclaved aerated concrete | | | [Nm] | 1. | 1 | 2 |
| Diameter of clearance | Pre-position anchorage | d _f ≤ | [mm] | 9 | 12 | 14 |
| hole in the fixture | Push through anchorage | d _f ≤ | [mm] | 11 | 14 | 16 |

¹⁾ $h_{ef,min} \le h_{ef} \le h_{ef,max}$ is possible.

fischer internal threaded anchor FIS E

FIS E 11x85 M6, FIS E 11x85 M8

FIS E 15x85 M10, FIS E 15x85 M12

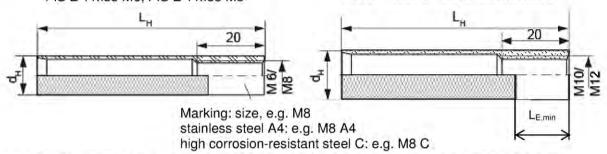


Table B1.2: Installation parameters for internal threaded anchor FIS E without perforated sleeve

| Size FIS E | | | M6 | M8 | M10 | M12 |
|--|---------------------------------|------|----|----|-----|-----|
| diameter of internal threaded anchor d _H [mm] | | | 1 | 1 | 1 | 5 |
| Nominal drill hole diameter | $d_{nom}=d_0$ | [mm] | 1 | 4 | 1 | 8 |
| Depth of drill hole | h ₀ | [mm] | | | 85 | |
| Effective anchorage depth | L _H =h _{ef} | [mm] | | | 85 | |
| Maximum torque moment | T _{inst, max} | [Nm] | 4 | | 10 | |
| Max. torque moment for autoclaved aerated concrete | T _{inst, max} | [Nm] | | | 1 | 2 |
| Diameter of clearance hole in the fixture | d _f ≤ | [mm] | 7 | 9 | 12 | 14 |
| Screw-in depth | L _{E,min} | [mm] | 6 | 8 | 10 | 12 |

| fischer Injectionsystem FORZA PRO for masonry | |
|---|-----------|
| Intended Use Installation parameters, part 1 | Annex B 3 |
| | |

Perforated sleeves FIS H 12x85; 16x85; 16x130; 20x85; 20x130; 20x200 K

Marking:size D_{Sleeve} x L_{Sleeve} e.g. 16x85






Table B1.3: Installation parameters (threaded rod and internal threaded anchor with perforated sleeve; only pre-positioned anchorage)


| Size FIS HK | | | 12x85 | 16x85 | 16x130 ²⁾ | 20x85 | 20x130 ²⁾ | 20x200 ²⁾ |
|--|-----------------------|------|--------|-------------------------|----------------------|---------------------------|----------------------|----------------------|
| Nominal drill hole diameter (d ₀ = D _{Sleeve}) | $d_{nom}=d_0$ | [mm] | 12 | | 16 | | 20 | |
| Depth of drill hole | ho | [mm] | 90 | 90 | 135 | 90 | 135 | 205 |
| Effective anchorage | h _{ef,min} | [mm] | 85 | 85 | 110 | 85 | 110 | 180 |
| depth ¹⁾ | h _{ef,max} | [mm] | 85 | 85 | 130 | 85 | 130 | 200 |
| Size of threaded rod | | [-] | M8 | M8, M10 | | M8, M10 M12 | | |
| Size of internal threaded anchor | | [-] | G-14-1 | FIS E 11x85 M6/M8 | 3444 | FIS E 15x85 M10/M12 | 2242 | |
| Maximum torque moment threaded rod and internal threaded anchor | T _{inst,max} | [mm] | 2 | | | | | |

fischer Injectionsystem FORZA PRO for masonry Annex B 4 Intended Use Installation parameters, part 2.

 $^{^{1)}}$ $h_{ef,min} \le h_{ef} \le h_{ef,max}$ is possible. $^{2)}$ Bridging of unbearing layer (e.g. plaster) possible



Cleaning brush BS (Steel brush)



Only for solid bricks and aerated concrete

Table B2: Parameters of steel brush

The size of the steel brush refers to the nominal drill bit diameter

| Drill hole diameter | d ₀ | [mm] | 10 | 12 | 14 | 16 | 18 | 20 |
|---------------------|--------------------|------|----|----|----|----|----|----|
| Brush diameter | d _{b,nom} | [mm] | 11 | 14 | 16 | 20 | 20 | 25 |

Maximum processing time of the mortar and minimum curing time Table B3: (During the curing time of the mortar the masonry temperature may not fall below the listed minimum temperature).

| 4 | 23.32 | | Minim | Minimum curing tim [minutes] | | | |
|--------------------------------------|-------|---|----------------------------|---|---------|--|--|
| Temperature at anchoring base [°C] | | FORZA PRO High Speed ³⁾ | FORZA PRO ²⁾ | FORZA PRO Low Speed ²⁾ | | | |
| -10 | to | -5 | 12 hours | | | | |
| >-5 | to | ±0 | 3 hours | 24 hours | | | |
| >±0 | to | +5 | 90 | 3 hours | 6 hours | | |
| >+5 | to | +10 | 45 | 90 | 3 hours | | |
| >+10 | to | +20 | 30 | 60 | 2 hours | | |
| >+20 | to | +30 | | 45 | 60 | | |
| >+30 | to | +40 | | 35 | 30 | | |

| System- | Maximum processing time t _{work} [minutes] | | | | | |
|-----------------------------------|---|----------------------------|---|--|--|--|
| temperature (mortar) [°C] | FORZA PRO High Speed ³⁾ | FORZA PRO ²⁾ | FORZA PRO Low Speed ²⁾ | | | |
| ±0 | 5 | | | | | |
| +5 | 5 | 13 | 20 | | | |
| +10 | 3 | 9 | 20 | | | |
| +20 | 1 | 5 | 10 | | | |
| +30 | | 4 | 6 | | | |
| +40 | | 2 | 4 | | | |

| fischer Injectionsystem FORZA PRO for masonry | |
|---|-----------|
| Intended Use | Annex B 5 |
| Steel brush | |
| Processing times and curing times | |

8.06.04-344/17 Z2933.18


¹⁾ For wet bricks the curing time must be doubled 2) Minimum cartridge temperature +5°C

³⁾ Minimum cartridge temperature ±0°C




Installation instructions part 1


Installation and Preparing the cartridge in solid brick and autoclaved aerated concrete (without perforated sleeve)




Drill the hole. Depth of drill hole h₀ and drill hole diameter d₀ see Table **B1.1** or **B1.2**










Blow out the drill hole two times by hand. Brush the drill hole two times using an adequate steel brush (see Table B2) and blow out two times again

3




Remove the sealing cap



Screw on the static mixer (the spiral in the static mixer must be clearly visible)


4




Place the cartridge into a suitable dispenser.



Press out approximately 10 cm of material until the mortar is permanently grey in colour. Mortar which is not grey in colour will not cure and must be disposed off.




Fill approximately 2/3 of the drill hole with mortar Always begin from the bottom of the hole to eliminate voids¹⁾.



For push through installation (not FIS E) fill the annular gap also with mortar.

6




Only use clean and oil-free anchor elements. Mark the threaded rod for setting depth. Press the threaded rod or internal threaded anchor FIS E down to the bottom of the hole, turning it slightly by hand while doing. After inserting the anchor element, excess mortar must emerge around the anchor element.

7



Wait for the specified curing time t_{cure} see Table **B3**



Mounting the fixture T_{inst,max} see Table **B1.1** or **B1.2**


fischer Injectionsystem FORZA PRO for masonry Intended Use Installation instructions part 1 in solid brick and aerated concrete Annex B 6

¹⁾ For the exact quantity of mortar see manufacturer's specification.



Installation instructions part 2

Installation in perforated or solid brick with perforated sleeve (pre-positioned anchorage)

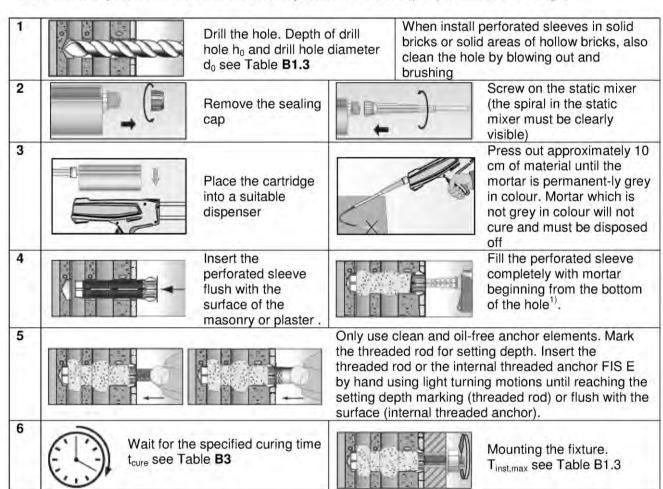

¹⁾ For the exact quantity of mortar see manufacturer's specification.

| fischer Injectionsystem FORZA PRO for masonry | |
|---|-----------|
| Intended Use Installation instructions part 2 in hollow brick masonry | Annex B 7 |

Z2933.18



Table B 4: Summary of bricks and blocks

| Brick No. 1 Solid brick Mz according to EN 771-2 $\rho \ge 1.8 \text{ [kg/dm}^3\text{]}$ fb $\ge 10 \text{ or } 20$ [N/mm ²] | | | Brick No. 6 Perforated brick HLz according to EN 771-1 $\rho \ge 1,4 \text{ [kg/dm}^3\text{]}$ fb $\ge 20 \text{ [N/mm}^2\text{]}$ | 22 - 14 - 28 |
|--|---|------------------------|--|--------------------|
| Brick No. 2 Solid sand-lime brick according to EN 771-2 $\rho \ge 1.8 \text{ [kg/dm}^3\text{]}$ fb $\ge 10 \text{ or } 20$ [N/mm²] | | | Brick No. 7 Perforated brick HLz according to EN 771-1 ρ≥1,0 [kg/dm³] fb≥10 [N/mm²] | |
| Brick No. 3 Solid sand-lime brick according to EN 771-2 $\rho \ge 1.8 \text{ [kg/dm}^3\text{]}$ fb $\ge 10 \text{ or } 20 \text{ [N/mm}^2\text{]}$ | | | Brick No. 8 Perforated brick HLz filled with mineral wool according to EN 771-1 p≥ 0,6 [kg/dm³] fb≥ 8 [N/mm²] | 2 |
| Brick No. 4 Sand-lime hollow brick according to EN 771-2 $\rho \ge 1.4 \text{ [kg/dm}^3\text{]}$ fb $\ge 12 \text{ or } 20$ [N/mm ²] | EL TOTAL STATE OF THE STATE OF | 5, "i "d" | Brick-No. 9 Light-weight concrete hollow block HbI according to EN 771-1 ρ≥ 1,0 [kg/dm³] fb≥ 4 [N/mm²] | 8 8 S |
| Brick No. 5 Perforated brick HLz according to EN 771-1 ρ≥ 0,9 [kg/dm³] fb≥ 10 [N/mm²] | | 94 184 122 10 | Brick No. 10 Autoclaved aerated concrete block $\rho \ge 0.35, 0.5 \text{ or}$ $0.65 \text{ [kg/dm}^3\text{]}$ fb $\ge 2, 4 \text{ or } 6$ [N/mm ²] | |

Imaging of the bricks are not scaled

| fischer Injectionsystem FORZA PRO for masonry | |
|--|-----------|
| Intended Use Types and dimensions of blocks and bricks | Annex B 8 |

English translation prepared by DIBt



Table B5.1: Allocation of threaded rods¹⁾, perforated sleeves¹⁾²⁾ and perforated or solid bricks

| Kind of masonry | Brick | Valid anchor rods and perfor | ated sleeves |
|--|--|------------------------------|---|
| Brick No. 1 Solid brick Mz according to EN 771-2 $\rho \ge 1,8 \text{ [kg/dm}^3\text{]}$ fb $\ge 10 \text{ or } 20$ $\text{[N/mm}^2\text{]}$ | 200 | | M8; M10; M12 FIS E 11x85 M6, M8 |
| Brick No. 2 Solid sand-lime brick according to EN 771-2 ρ ≥ 1,8 [kg/dm³] fb ≥ 10 or 20 [N/mm²] | | | M8; M10; M12 FIS E 11x85 M6, M8 |
| Brick No. 3 Solid sand-lime brick according to EN 771-2 ρ ≥ 1,8 [kg/dm³] fb ≥ 10 or 20 [N/mm²] | STI STILL ST | | FIS H 12x85 K FIS H 16x85 K FIS H 20x85 K FIS H 16x130 K FIS H 20x130 K |
| Brick No. 4 Sand-lime hollow brick according to EN 771-2 p ≥ 1,4 [kg/dm³] fb ≥ 12 or 20 [N/mm²] | 5 40 | | FIS H 12x85 K FIS H 16x85 K FIS H 20x85 K FIS H 16x130 K FIS H 20x130 K |
| Brick No. 5 Perforated brick HLz according to EN 771-1 ρ ≥ 0,9 [kg/dm³] fb ≥ 10 [N/mm²] | 119 | | FIS H 12x85 K FIS H 16x85 K FIS H 20x85 K FIS H 16x130 K FIS H 20x130 K |
| Brick No. 6 Perforated brick HLz according to EN 771-1 ρ≥ 1,4 [kg/dm³] fb≥ 20 [N/mm²] | | | FIS H 12x85 K FIS H 16x85 K FIS H 20x85 K |

¹⁾ Other combinations can be used after job site tests acc. to ETAG 029, Annex B. ²⁾ Sleeve/anchor rod combination see table B1.3

The β- factor for this job site tests are given in Table C4

Imaging of the bricks are not scaled

| fischer Injectionsystem FORZA PRO for masonry | |
|---|-----------|
| Intended Use Allocation of threaded rods, perforated sleeves and bricks, part 1 | Annex B 9 |



Table B5.2: Allocation of threaded rods¹⁾, perforated sleeves¹⁾²⁾ and perforated or solid bricks

| Kind of masonry | Brick | Valid anchor rods and perforated sleeves | | |
|---|--|--|---|--|
| Brick No. 7 Perforated brick HLz according to EN 771-1 ρ ≥ 1,0 [kg/dm³] fb ≥ 10 [N/mm²] | A STATE OF THE STA | | FIS H 12x85 K FIS H 16x85 K FIS H 20x85 K FIS H 20x130 K | |
| Brick No. 8 Perforated brick HLz filled with mineral wool according to EN 771-1 ρ ≥ 0,6 [kg/dm³] fb ≥ 8 [N/mm²] | | | FIS H 12x85 K FIS H 16x85 K FIS H 20x85 K FIS H 16x130 K FIS H 20x130 K FIS H 20x200 K | |
| Brick-No. 9 Light-weight concrete hollow block Hbl according to EN 771-1 ρ≥ 1,0 [kg/dm³] fb≥ 4 [N/mm²] | | | FIS H 12x85 K FIS H 16x85 K FIS H 20x85 K FIS H 16x130 K FIS H 20x130 K | |
| Brick No. 10 Autoclaved aerated concrete | | | M8; M10; M12 | |
| block $\rho \ge 0,35, 0,5 \text{ or}$ $0,65 \text{ [kg/dm}^3\text{]}$ fb ≥ 2, 4 or 6 [N/mm ²] | | | FIS E 11x85 M6 FIS E 11x85 M8 FIS E 15x85 M10 FIS E 15x85 M12 | |

 $^{^{1)}}$ Other combinations can be used after job site tests acc. to ETAG 029, Annex B. $^{2)}$ Sleeve/anchor rod combination see table B1.3

The β- factor for this job site tests are given in Table C4

Imaging of the bricks are not scaled

| fischer Injectionsystem FORZA PRO for masonry | |
|--|------------|
| Intended Use | Annex B 10 |
| Allocation of threaded rods, perforated sleeves and bricks, part 2 | |

English translation prepared by DIBt



| Table C1.1: | Characteristic values of resistance under tension loads and under |
|-------------|---|
| | shear loads |

| Brick | Density p | | Anchor size or screw size in internal threaded anchor | | Effective anchorage | | Characteristic resistance [kN] | | |
|--------------------------|-------------------------------------|--------------------------------|---|---------------------|-----------------------------|------------------|--------------------------------|-----------------|--|
| | [kg/dm ³] | Perforated sleeve FIS HK | | depth | | N _{Rk} | | V _{Rk} | |
| | Compressive strength f _b | | | h _{ef,min} | h _{ef,max} [mm] | Temp. 50/80°C | | All categories | |
| | [N/mm ²] | | | [mm] | | d/d | w/w | | |
| | | | M8 | 50 | 200 | 4,0 | 2,5 | 2,5 | |
| | | | M10 | 50 | 79 | 3,5 | 2,0 | 4,0 | |
| | | | M10 | 80 | 199 | 5,0 | 3,0 | 4,0 | |
| | ρ≥1,8 | | M10 | 200 | 200 | 8,5 | 7,5 | 8,5 | |
| | f _b ≥ 10 | | M12 | 50 | 79 | 3,0 | 2,0 | 4.0 | |
| 140 . | | | M12 | 80 | 199 | 5,5 | 3,5 | 4,0 | |
| t. | | | M12 | 200 | 200 | 8,0 | 5,0 | 8,5 | |
| E | | 10000 | FIS E 11x85 M6/ M8 | 85 | 85 | 5,5 | 3,5 | 2,5 | |
| 100 | ρ≥ 1,8 f _b ≥ 20 | without | M8 | 50 | 200 | 5,5 | 3,5 | 4,0 | |
| No.1 | | | M10 | 50 | 79 | 5,0 | 3,0 | 0.0 | |
| Solid brick Mz | | | M10 | 80 | 199 | 7,0 | 4,5 | 6,0 | |
| | | | M10 | 200 | 200 | 8,5 | 8,5 | 8,5 | |
| | | | M12 | 50 | 79 | 4,5 | 3,0 | | |
| | | | M12 | 80 | 199 | 8,0 | 5,0 | 5,5 | |
| | | | M12 | 200 | 200 | 8,5 | 7,0 | 8,5 | |
| | | n and | FIS E 11x85 M6/ M8 | 85 | 85 | 8,0 | 5,0 | 4,0 | |
| 1 | | | M8 | 50 | 200 | 2,5 1,5 | | | |
| | ρ ≥ 1,8 f _b ≥ 10 | | M10 | 50 | 79 | | 1,5 | 4.0 | |
| | | | M10 | 80 | 199 | | | 4,0 | |
| | | | M10 | 200 | 200 | 8,5 | 6,0 | | |
| | | | M12 | 50 | 79 | 0.5 | 44 | 5,0 | |
| 1/2 | | | M12 | 80 | 199 | 2,5 | 1,5 | | |
| | | | M12 | 200 | 200 | 8,5 | 6,5 | | |
| 1 | | without | FIS E 11x85 M6/ M8 | 85 | 85 | 2,5 | 1,5 | 3,0 | |
| 240 | | | M8 | 50 | 200 | 3,5 | 7 | | |
| No.2 | | | M10 | 50 | 79 | | 2,0 | 5.5 | |
| Solid sand-lime brick | 10223 | | M10 | 80 | 199 | | 1 | 5,5 | |
| 50.20 | ρ≥ 1,8 f _b ≥ 20 | | M10 | 200 | 200 | 8,5 | 8,5 | | |
| | 1b = 20 | 4.1 | M12 | 50 | 79 | 3.5 | 20 | | |
| | | | M12 | 80 | 199 | 3,5 2,0 | 7,0 | | |
| | | | M12 | 200 | 200 | 8,5 | 8,5 | | |
| | | | FIS E 11x85 M6/ M8 | 85 | 85 | 3,5 | 2,0 | 4,0 | |

Imaging of the bricks are not scaled

| fischer Injectionsystem FORZA PRO for masonry | |
|---|-----------|
| Performances | Annex C 1 |
| Characteristic values of resistance under tension loads and under shear loads, part 1 | |



| Table C1.2: | | acteristic r loads | values of resista | ance u | nder te | nsion | load | s and unde | | |
|--------------------------|---|-----------------------|--------------------------------|---------------------|---------------------|-------------|------------------|------------------------|-----|--|
| Brick | Density p | | Anchor size or | | ctive orage | Char | | stic resistance kN] | | |
| | [kg/dm ³] Compressive strength f _b [N/mm ²] | Compressive | Perforated | screw size in | depth | | N _{Rk} | | VRk | |
| | | | sleeve FIS HK | internal threaded | | | Temp. 50/80°C | | | |
| | | | anchor | h _{ef,min} | h _{ef,max} | 50/8 d/d | w/w | All categories | | |
| | [iv/unit] | 12x85 | M8 | [mm] 85 | [mm] 85 | 6,0 | 3,5 | | | |
| | + | 16x85 | FIS E 11x85 M6 | 85 | 85 | 3,5 | 2,0 | 3,0 | | |
| | ρ≥1,8 | 16x85 | M8/M10, FIS E 11x85 M8 | 85 | 85 | 3,5 | 2,0 | | | |
| 100 | f _b ≥ 10 | 20x85 | M12, FIS E 15x85 M10/M12 | 85 | 85 | 8,5 | 6,5 | 3,5 | | |
| ,97 | 1 | 16x130 | M8/M10 | 110 | 130 | 3,5 | 2,0 | | | |
| | | 20x130 | M12 | 110 | 130 | 7,0 | 4,5 | | | |
| 10 | ρ≥1,8 | 12x85 | M8 | 85 | 85 | 8,5 | 5,0 | 4,5 | | |
| No.3 | f _b ≥ 20 | 16x85 | FIS E 11x85 M6 | 85 | 85 | 5,5 | 3,0 | 4,5 | | |
| Solid sand-lime brick | | 16x85 | M8/M10, FIS E 11x85 M8 | 85 | 85 | 5,5 | 3,0 | | | |
| | | 20x85 | M12, FIS E 15x85 M10/M12 | 85 | 85 | 8,5 | 8,5 | 5,5 | | |
| | | 16x130 | M8/M10 | 110 | 130 | 5,0 | | | | |
| | | 20x130 | M12 | 110 | 130 | 8,5 | 6,0 | | | |
| | ρ≥1,4 | 12x85 | M8 | 85 | 85 | 2,5 | 2,5 | 2,5 | | |
| | | 16x85 | FIS E 11x85 M6 | 85 | 85 | 3,0 | 2,5 | 2,5 | | |
| | | 16x85 | M8/M10, FIS E 11x85 M8 | 85 | 85 | 3,0 | 2,5 | 4,5 | | |
| 146 . | f _b ≥ 12 | 20x85 | M12, FIS E 15x85 M10/M12 | 85 | 85 | 3,5 | 3,0 | 4,5 | | |
| 200 | | 16x130 | M8/M10 | 110 | 130 | 3,5 | 3,0 | 4,5 | | |
| 1 | 4 | 20x130 | M12 | 110 | 130 | | | | | |
| 40 | | 12x85 | M8 | 85 | 85 | 4,5 | 4,0 | 4,5 | | |
| No.4 Sand-lime hollow | | 16x85 | FIS E 11x85 M6 | 85 | 85 | 5,0 | 4,0 | 4,0 | | |
| brick | ρ≥1,4 | 16x85 | M8/M10, FIS E 11x85 M8 | 85 | 85 | 5,0 | 4,5 | 7,5 | | |
| | f _b ≥ 20 | 20x85 | M12, FIS E 15x85 M10/M12 | 85 | 85 | 60 | 5,5 | 7.5 | | |
| | | 16×130 | M8/M10 | 110 | 130 | 6,0 | 0,5 | 7,5 | | |
| | | 20x130 | M12 | 110 | 130 | | | | | |

fischer Injectionsystem FORZA PRO for masonry

Performances
Characteristic values of resistance under tension loads and under shear loads, part 2

Annex C 2

electronic copy of the eta by dibt: eta-17/0785

Table C1.3: Characteristic values of resistance under tension loads and under shear loads

| | Density ρ [kg/dm³] | Perfor- | Anchor size or screw size | anch | ctive orage pth | | | teristic ice [kN] | |
|------------------------------|--|--|------------------------------|---------------------|-----------------------|-------------------------------|-----|--------------------------------|--|
| Brick | Compressive | ated sleeve | in internal threaded | | | N _{Rk} Temp. 50/80°C | | V _{Rk} All categories | |
| | strength f _b [N/mm ²] | FIS HK | anchor | h _{ef,min} | h _{ef,max} | | | | |
| | | | | [mm] | [mm] | d/d | w/w | , categories | |
| 170 | | 12x85 | M8 | 85 | 85 | 4,0 | 3,5 | 4,0 | |
| 1 | | 16x85 | FIS E 11x85 M6 | 85 | 85 | 3,5 | 3,5 | 4,0 | |
| | ρ≥0,9 | 16x85 | M8/M10, FIS E 11x85 M8 | 85 | 85 | 3,5 | 3,5 | 5,5 | |
| 40 | f _b ≥ 10 | 20x85 | M12, FIS E 15x85 M10/M12 | 85 | 85 | 5,0 | 4,5 | 6,0 | |
| No.5 Perforated brick HLz | | 16x130 | M8/M10 | 130 | 130 | 5,0 | 4,5 | 5,5 | |
| | | 20x130 | M12 | 110 | 130 | 5,0 | 4,5 | 6,0 | |
| 44.4 | | 12x85 | M8 | 85 | 85 | 4,0 | 3,5 | 7,5 (5,5)1) | |
| | $\rho \ge 1.4$ $f_b \ge 20$ | 16x85 | FIS E 11x85 M6 | 85 | 85 | 2,5 | | 4,0 | |
| 1 | | 11,4 20 16x85 M8/M10, FIS E 11x85 M8 85 85 | | | | | ,5 | 4,5 | |
| No.6 Perforated brick HLz | | 20x85 | M12, FIS E 15x85 M10/M12 | 85 85 | | 3 | ,0 | 8,5 (5,5) ¹⁾ | |
| 12 (Jan) | - | 12x85 | M8 | 85 | 85 | 0 | ,9 | | |
| | ρ≥ 1,0 f _b ≥ 10 | 16x85 | M8/M10, FIS E 11x85 M6/M8 | 85 | 85 | | | 1,2 | |
| | | 20x85 | M12, FIS E 15x85 M10/M12 | 85 85 | | 2 | ,5 | | |
| 47/00 | | 16x130 | M8/M10 | 110 130 | | | 1,5 | | |
| No.7 Perforated brick HLz | | 20x130 | M12 | 110 | 130 | 3,5 | 3,0 | 1,5 | |
| | | 12x85 | M8 | 85 | 85 | 2,0 | 2,0 | 2,5 | |
| | 1 0 4 | 16x85 | FIS E 11x85 M6 | 85 | 85 | 2,0 | 1,5 | 2,5 | |
| 1 | ρ≥0,6 | 16x85 | M8/M10, FIS E 11x85 M8 | 85 | 85 | 2,0 | 1,5 | 3,0 | |
| | f _b ≥ 8 | 20x85 | M12, FIS E 15x85 M10/M12 | 85 | 85 | 2,0 | 2,0 | 1,5 | |
| No C Dorforotod bulgle (0 - | 12.00 | 16x130 | M8/M10 | 130 | 130 | 3,0 | 2,5 | 3,0 | |
| No.8 Perforated brick HLz | | 20x130 | M12 | 110 | 130 | 2,0 | 2,0 | 1,5 | |
| | | 20x200 | M12 | 180 | 200 | 3,0 | 3,0 | 1,5 | |
| Yes a | | 12x85 | M8 | 85 | 85 | | | | |
| | ρ≥1,0 | p ≥ 1,0 | | 85 | 85 | 3,0 | | 2,0 | |
| 1 | f _b ≥ 4 | 20x85 | M12, FIS E 15x85 M10/M12 | 85 | 85 | | ,,, | 2,0 | |
| No.9 Light-weight | | 16x130 | M8/M10 | 130 | 130 | | | | |
| concrete hollow block | | 20x130 | M12 | 110 | 130 | 11 | | | |

 $^{^{1)}}$ Characteristic value of pushing out of one brick $V_{\text{Rk},\text{pb}}$ = 5,5 kN Imaging of the bricks are not scaled

| fischer Injectionsystem FORZA PRO for masonry | |
|--|-----------|
| Performances Characteristic values of resistance under tension loads and under shear loads, part 3 | Annex C 3 |

English translation prepared by DIBt



| Table C1.4: | Characte shear loa | | ues of resistan | ce un | der ter | nsion | load | s and und | |
|------------------------|-------------------------------------|--------------|--|---------------------------------|-----------------------------|------------------|---------------------|-----------------|--|
| | Density p [kg/dm ³] | | J. T. V. | Effective anchorage depth | | Chara | ic resistance N] | | |
| Brick | Compressive strength f _b | | Anchor size or screw size in | | | N _{Rk} | | V _{Rk} | |
| | | | internal threaded anchor | | | Temp. 50/80°C | | All | |
| | [N/mm ²] | | | h _{ef,min} [mm] | h _{ef,max} [mm] | d/d | w/w | categories | |
| | | | M8 | 100 | 120 | | | 1,2 | |
| | | | M10 | 100 | 120 | | | 1,2 | |
| | ρ≥ 0,35 | and the same | M12 | 100 | 120 | | 2 | 1,5 | |
| | f _b ≥ 2 | without | FIS E 11x85 M6/M8 FIS E 15x85 M10/M12 | 85 | | 1,5 | | 1,2 | |
| Telephone I | | | M8 | 100 | 120 | 2 | ,0 | 2,5 | |
| | | | M10 | 100 | 120 | 2,5 | | 2,0 | |
| | ρ≥0,5 | 10 Mile 22 A | M12 | 100 | 120 | | | 2,5 | |
| No.10 Aerated concrete | f _b ≥ 4 | | FIS E 11x85 M6/M8 FIS E 15x85 M10/M12 | 85 | | 2,0 | | 2,0 | |
| lock | | | M8 | 100 | 120 | 3,5 | 3,0 | 3,0 | |
| | | | M10 | 100 | 120 | EO | 1.5 | 3,0 | |
| | ρ≥0,65 | codele avai | M12 | 100 | 120 | 5,0 | 4,5 | 3,5 | |
| | $\rho \ge 0.65$ $f_b \ge 6$ without | | rithout FIS E 11x85 M6/M8 FIS E 15x85 M10/M12 | | 5 | 3,5 | | 2,5 | |

Imaging of the bricks are not scaled

| fischer Injectionsystem FORZA PRO for masonry | |
|---|-----------|
| Performances | Annex C 4 |
| Characteristic values of resistance under tension loads and under shear loads, part 4 | |



Table C2: Characteristic bending moments

| Size | | | | | M8 | M10 | M12 |
|------|----------------------------------|--------------------|-----------------------|----------|-----|-----|-----|
| | | Zina alatad ataal | Property class | 5.8 [Nm] | 19 | 37 | 65 |
| б | Zinc-plated steel | 8.8 [Nm] | 30 | 60 | 105 | | |
| ğ | | Ctainless stool A. | Dranauti alana | 50 [Nm] | 19 | 37 | 65 |
| per | K,S | Stainless steel A4 | Property class | 70 [Nm] | 26 | 52 | 92 |
| stic | M _{RK,s} | | | 80[Nm] | 30 | 60 | 105 |
| teri | | | | 50 [Nm] | 19 | 37 | 65 |
| | High corrosion-resistant steel C | Property class | 70 ¹⁾ [Nm] | 26 | 52 | 92 | |
| | J.Co. | | 80 [Nm] | 30 | 60 | 105 | |

¹⁾ $f_{uk} = 700 \text{ N/mm}^2$; $f_{yk} = 560 \text{ N/mm}^2$

Table C2.1: Characteristic bending moments for internal threaded anchors FIS E

| Size FIS | Size FIS E | | | | M8 | M10 | M12 |
|--|---|-------------------------------|----------|----|----|-----|-----|
| | zinc | Property | 5.8 [Nm] | 8 | 19 | 37 | 65 |
| bending M _{Rk,s} | plated steel, | class of screw | 8.8 [Nm] | 12 | 30 | 60 | 105 |
| aracteristic beno moments M _{RK,s} | stainless steel A4 | Property class of screw | 70 [Nm] | 11 | 26 | 52 | 92 |
| Characteristic moments N | high corrosion resistant steel C | Property class of screw | 70 [Nm] | 11 | 26 | 52 | 92 |

Tabelle C3: Displacements under tension loads and shear loads

| Material | N [kN] | δN ₀ [mm] | δN∞ [mm] | V [kN] | δV ₀ [mm] | δV∞ [mm] |
|---|---|-------------------------|-------------|--------------------------------------|-------------------------|-------------|
| solid units and autoclaved aerated – concrete | N _{Rk} | - 0,03 | 0,06 | V _{Rk} 1,4 * γ _M | 0,59 | 0,88 |
| hollow units | N _{Rk} 1,4 * γ _M | - 0,03 | 0,06 | V _{Rk} 1,4 * γ _M | 1,71 | 2,56 |

| fischer Injectionsystem FORZA PRO for masonry | |
|---|-----------|
| Performances | Annex C 5 |
| Characteristic bending moments; displacements | |



Table C4: β- factor for job site tests according to ETAG 029, Annex B

| Using categories | w/w | d/d | |
|-----------------------------|-------------------------------------|-------|------|
| Temperature range | 50/80 | 50/80 | |
| Brick | Size ¹⁾ | | |
| | M8 | 0,57 | |
| | M10 | 0,59 | 0,96 |
| Solid brick | M12 FIS E 11x85 | | 0,96 |
| | M6 / M8 FIS E 15x85 M10 / M12 | 0,60 | |
| Hollow brick | All sizes | 0,86 | 0,96 |
| Autoclaved aerated concrete | All size | 0,73 | 0,81 |

| fischer Injectionsystem FORZA PRO for masonry | |
|---|-----------|
| Performances | Annex C 6 |
| β- factors for job site tests | |




Edge distance and spacing (installation with and without sleeves) Table C5:

| Direction t | o bed joint | | _ | L | | | | Grou | ıp fac | tor | Min. thickness | |
|-------------|-----------------|---|------------------|-----------------|------------------|-----------------|-----------------------|----------------|-----------------------|----------------|---------------------------|--|
| Brick No. | h _{ef} | C _{cr} =C _{min} | S _{min} | S _{cr} | S _{min} | S _{cr} | Т | | | | of the masonry members | |
| Briok Ho. | [mm] | [mm] | [mm] | [mm] | [mm] | [mm] | $\alpha_{\text{g,N}}$ | $\alpha_{g,V}$ | $\alpha_{\text{g,N}}$ | $\alpha_{g,V}$ | [mm] | |
| | 50 | 100 | 7 | 5 | 60 ¹⁾ | 150 | 2 | 2 | 1,5 | 1,4 | | |
| 1 | 80 | 100 | 7 | 5 | 60 ¹⁾ | 240 | 2 | 2 | 1,5 | 1,4 | | |
| | 200 | 150 | 7 | 5 | 2 | 40 | | | 2 | | | |
| | 50 | 100 | 7 | 5 | 2 | 40 | | | 2 | | | |
| 2 | 80 | 100 | 75 | | 75 240 2 | | | | | | | |
| | 200 | 150 | 75 | | 75 240 2 | | 2 | | | | | |
| 3 | 85 | 100 | 1 | 15 | 2 | 40 | | | 2 | | | |
| | 130 | 100 | 1 | 15 | 2 | 40 | | | 2 | | h _{ef} + 30 | |
| 4 | all sizes | 100 | 1 | 15 | 100 | 240 | 2 | 2 | 1,5 | 1,5 | (≥ 80) | |
| 5 | all sizes | 100 | 1 | 15 | 2 | 40 | | | 2 | | | |
| 6 | all sizes | 100 | 1 | 15 | 2 | 40 | | | 2 | | | |
| 7 | all sizes | l sizes 100 100 240 100 $\frac{375}{(500)^2}$ 1 | | 1 | 1 | 1 | | | | | | |
| 8 | all sizes | 120 | 24 | 45 | 2 | 50 | 2 | | | | | |
| 9 | all sizes | 80 | 24 | 40 | 3 | 65 | 2 | | | | | |
| 10 | all sizes | 100 | 25 | 50 | 3 | 00 | 2 | | | | | |

 $^{^{1)}}$ only valid for tension loads, for shear loads $s_{min} \big\| = s_{cr} \big\|$ spacing for alternative brick dimension, see table B4, brick 7

fischer Injectionsystem FORZA PRO for masonry Annex C 7 **Performances** Edge distance and spacing



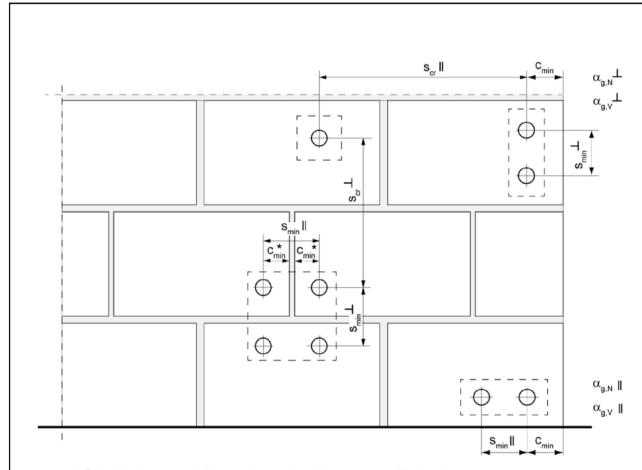

* Only, if joints are visible and/or vertical joints are not filled with mortar

 $s_{min} II = Minimum spacing parallel to bed joint$

 s_{min}^{\perp} = Minimum spacing vertical to bed joint

s_{cr} II = Characteristic spacing parallel to bed joint

 s_{cr}^{\perp} = Characteristic spacing vertical to bed joint

 $c_{cr} = c_{min}$ = Edge distance

 $\alpha_{o,N}$ II = Group factor for tension load parallel to bed joint

 $\alpha_{o,V}$ II = Group factor for shear load parallel to bed joint

 $\alpha_{a,N} \perp$ = Group factor for tension load vertical to bed joint

 $\alpha_{\text{GV}} \perp$ = Group factor for shear load vertical to bed joint

For $s > s_{cr}$ $\alpha_q = 2$

For $s_{min} \le s \le s_{cr}$ α_g according to table C5 $N^g_{Rk} = \alpha_{g,N} \bullet N_{Rk}$; $V^g_{Rk} = \alpha_{g,V} \bullet V_{Rk}$ (Group of 2 anchors) $N^g_{Rk} = \alpha_{g,N} \coprod \bullet \alpha_{g,N} \coprod \bullet N_{Rk}$; $V^g_{Rk} = \alpha_{g,V} \coprod \bullet \alpha_{g,V} \coprod \bullet V_{Rk}$ (Group of 4 anchors)

fischer Injectionsystem FORZA PRO for masonry

Performance

Definition of minimum edge distance, minimum spacing and group factors

Annex C 8